



JOINT SERVICE TRENCH TYPICAL : WITH GAS

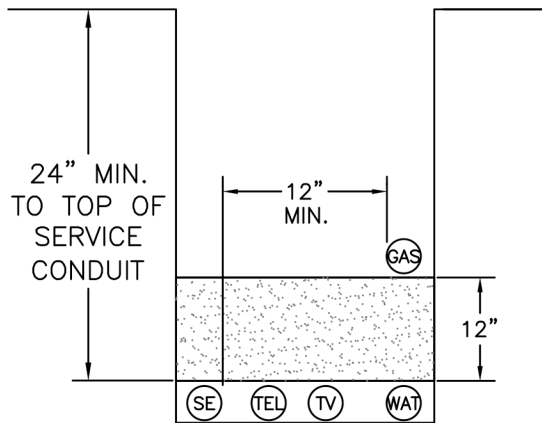

MAINTAIN 12" HORIZONTAL SEPERATION & 12" VERTICAL SEPERATION BETWEEN GAS & SE CONDUIT

CLEARANCE BETWEEN ELECTRICAL METER BASE, GAS METER AND WINDOWS

UNDERGROUND/OVERHEAD RESIDENTIAL SERVICES

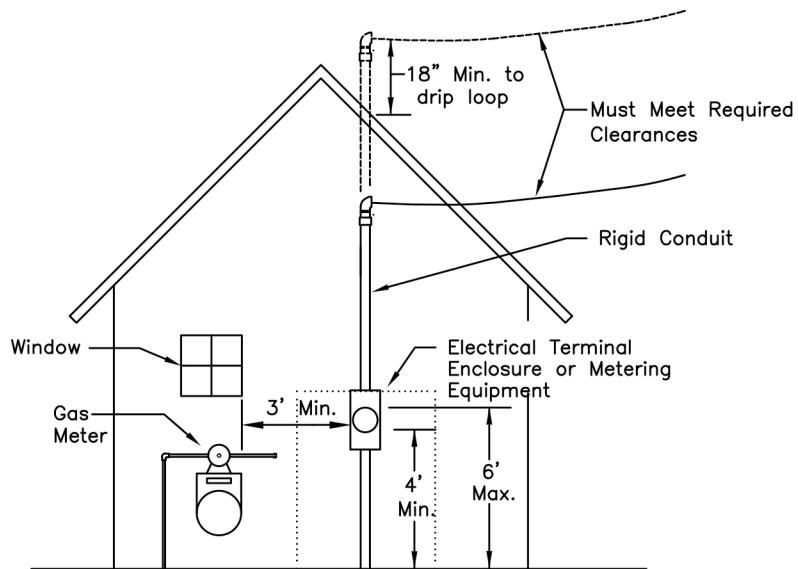


NESC Requires Clear Working Space of 75" High x 36" Wide x 36" in Front

3-foot minimum clear working space required between electric meter and gas meter.

UNDERGROUND SERVICE

SERVICE DETAIL
SINGLE FAMILY DWELLING
MEMBER SUPPLIED TRENCH AND CONDUIT

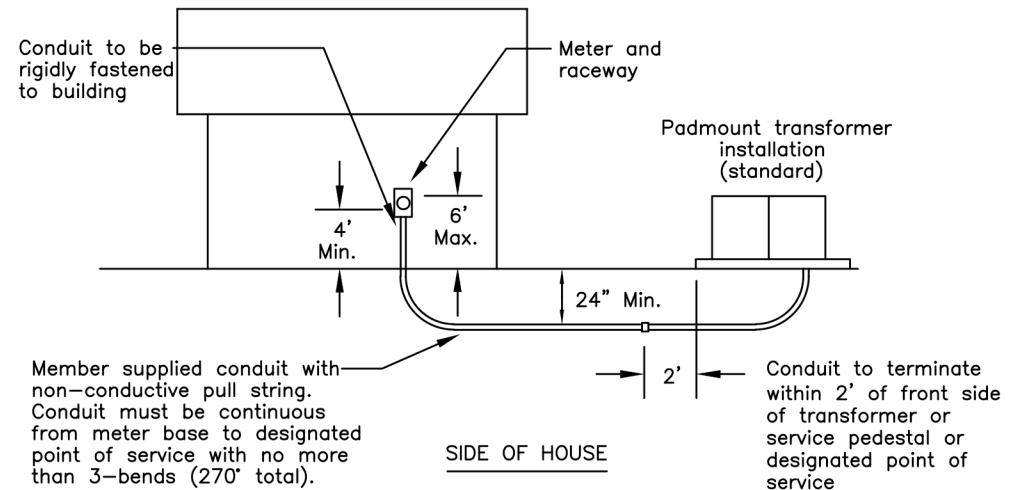

NOTES:

- PLACE METER ON SIDE OF BUILDING CLOSEST TO SE FACILITIES
- FOR 200 AND 320 AMP RESIDENTIAL SERVICES USE 3" PVC
- TRENCH INSPECTION REQUIRED BEFORE BACKFILL
- UTILITY TO SUPPLY AND INSTALL CONDUCTOR TO METER BASE
- CITY/COUNTY INSPECTION LABEL MUST BE ON METER BASE
- FOR MULTIPLE UNITS, PERMANENTLY ENGRAVED HARD LABEL REQUIRED



SALEM ELECTRIC
AN ELECTRIC COOPERATIVE